


PLAN  
CONCRETE ENCASEMENT

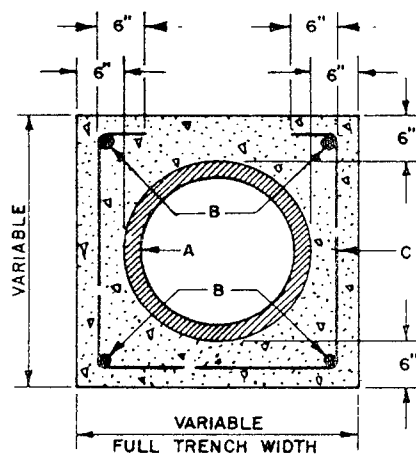

SECTION A-A

### GENERAL NOTES:

1. WHERE A WATER LINE PASSES BENEATH OR LESS THAN 18 IN. ABOVE AN EXIST. SEWER LINE, THE SEWER LINE SHALL BE ENCASED IN CONC. 6" THICK AS DETAILED, FOR AT LEAST 10 FT. ON EACH SIDE OF THE WATER LINE, OR THE SEWER LINE SHALL BE D.I. OR C-900 PVC PIPE WITH PRESSURE-TYPE JOINTS FOR AT LEAST 10 FT. ON EACH SIDE OF THE WATER LINE. THIS SHALL ALSO APPLY WHERE A PARALLEL WATER LINE IS LESS THAN 10 FT. HORIZONTALLY AND LESS THAN 2 FT. ABOVE THE SEWER LINE.

### CONSTRUCTION NOTES:

- A. SANITARY SEWER LINE AS SHOWN ON PLANS.
- B. 4--NO. 4 BARS, CONT. WITH 3" CLEARANCE.
- C. NO. 4 BARS, AT 36" O.C.

REVISIONS	CITY OF ALBUQUERQUE
	SEWER ENCASEMENT DETAILS DWG. 2140 AUG. 1986